TR-05664

Powersafe Panel Source T8



Test Date: 07/07/16 Operator: D.Maclachlan

TYPE AND DESCRIPTION OF TEST

POWERSAFE PANEL SOURCE T8. DIRECT RESISTANCE WITH 800A CURRENT.

OBJECTIVE

The object of this test is to assess the current carrying capacity of the Powersafe Panel Source T8 connector.

TEST METHOD

A specified test current shall be applied to the contacts of the specimen for a minimum period of 3 hours or until equilibrium is reached. (Less than 1 degree per hour). The Powersafe Connectors will be fed with between 800A and 815A from the 3000A load unit via 2 x 1m lengths of HO7RN-F single core 300mm² cable.

REQUIREMENTS

The connectors must be capable of carrying the specified test current for a minimum period of 3 hours without exceeding the specified temperature rise.

TEST ITEMS

1x Powersafe C300 Line Drain Connector terminated with 300mm² cable 1x Powersafe Panel Source T8 Connector terminated with A30-M12 Lug on 300mm² cable

EQUIPMENT USED

| INSTRUMENT | DESCRIPTION | CALIBRATION EXPIRY DATE |
|---------------------|---|-------------------------|
| Current Generation | T & R PCU1 Mk3 P.C.I.T.S. (21TE0216) | 20/01/2017 |
| External Load Unit | 3000A Loading Unit | 20/01/2017 |
| Digital Thermometer | YF-160A Thermocoupler + 6 Probes | 04/02/2017 |




This report is the property of Phase 3 Connectors Ltd and must not, without their written consent, be passed on, copied or used for any other purpose.

TR-05664

Powersafe Panel Source T8



Test Date: 07/07/16 Operator: D.Maclachlan

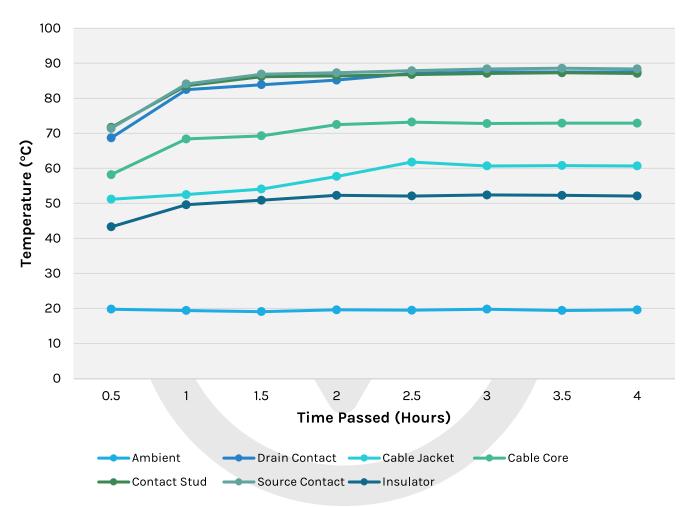

| TIME | AMBIENT | DRAIN CONTACT | CABLE JACKET | CABLE CORE | CONTACT STUD | SOURCE CONTACT | INSULATOR | AMPS |
|------|---------|------------------|-----------------|---------------|-----------------|-------------------|-----------|-------|
| 0.5 | 19.8 | 68.7 | 51.2 | 58.2 | 71.7 | 71.4 | 43.3 | 814.0 |
| 1 | 19.4 | 82.5 | 52.5 | 68.4 | 83.6 | 84.1 | 49.6 | 808.0 |
| 1.5 | 19.1 | 83.9 | 54.1 | 69.3 | 86.2 | 86.9 | 50.9 | 806.0 |
| 2 | 19.6 | 85.2 | 57.7 | 72.5 | 86.4 | 87.3 | 52.3 | 804.0 |
| 2.5 | 19.5 | 87.1 | 61.8 | 73.2 | 86.8 | 87.9 | 52.1 | 802.0 |
| 3 | 19.8 | 87.5 | 60.7 | 72.8 | 87.1 | 88.4 | 52.4 | 802.0 |
| 3.5 | 19.4 | 87.5 | 60.8 | 72.9 | 87.3 | 88.6 | 52.3 | 805.0 |
| 4 | 19.6 | 87.5 | 60.7 | 72.9 | 87.1 | 88.4 | 52.1 | 805.0 |

TR-05664

Powersafe Panel Source T8



Test Date: 07/07/16 Operator: D.Maclachlan

FINAL RESULTS

| PROBE POSITION | TEMPERATURE (C) | T (MEASURED-AMBIENT) | AMPS |
|-----------------------------|-----------------|----------------------|------|
| Ambient | 19.6 | N/A | N/A |
| Line Drain Contact (P1) | 87.5 | 67.9 | 805A |
| Cable Jacket (P2) | 60.7 | 41.1 | 805A |
| Cable Core (P3) | 72.9 | 53.3 | 805A |
| Panel Contact Stud (P4) | 87.1 | 67.5 | 805A |
| Panel Source Contact (P5) | 88.4 | 68.8 | 805A |
| Panel Source Insulator (P6) | 52.1 | 32.5 | 805A |

CONCLUSION

| MEASUREMENT | RESULT |
|---|--------|
| Maximum Allowable Temperature | 125°C |
| Maximum Recorded Temperature Rise @ Insulated Body (above ambient) | 32.5°C |
| Maximum Allowable Temperature of Contacts | 125°C |
| Maximum Recorded Temperature Rise (above ambient) | 68.8°C |
| TEMPERATURE RISE WITHIN BS EN 61984 -2009 AND VDE ALLOWABLE LIMITS. | PASS |







This report is the property of Phase 3 Connectors Ltd and must not, without their written consent, be passed on, copied or used for any other purpose.