

TR-05664

# Powersafe Panel Source T8



Test Date: 07/07/16 Operator: D.Maclachlan

## TYPE AND DESCRIPTION OF TEST

POWERSAFE PANEL SOURCE T8. DIRECT RESISTANCE WITH 800A CURRENT.

## OBJECTIVE

The object of this test is to assess the current carrying capacity of the Powersafe Panel Source T8 connector.

## TEST METHOD

A specified test current shall be applied to the contacts of the specimen for a minimum period of 3 hours or until equilibrium is reached. (Less than 1 degree per hour).

The Powersafe Connectors will be fed with between 800A and 815A from the 3000A load unit via 2 x 1m lengths of HO7RN-F single core 300mm<sup>2</sup> (600MCM) cable.

## REQUIREMENTS

The connectors must be capable of carrying the specified test current for a minimum period of 3 hours without exceeding the specified temperature rise.

## TEST ITEMS

1x Powersafe C300 Line Drain Connector terminated with 300mm<sup>2</sup> (600MCM) cable

1x Powersafe Panel Source T8 Connector terminated with A30-M12 Lug on 300mm<sup>2</sup> (600MCM) cable

## EQUIPMENT USED

INSTRUMENT	DESCRIPTION	CALIBRATION EXPIRY DATE
Current Generation	T & R PCU1 Mk3 P.C.I.T.S. (21TE0216)	20/01/2017
External Load Unit	3000A Loading Unit	20/01/2017
Digital Thermometer	YF-160A Thermocoupler + 6 Probes	04/02/2017




This report is the property of Phase 3 Connectors Ltd and must not, without their written consent, be passed on, copied or used for any other purpose.

TR-05664

# Powersafe Panel Source T8



Test Date: 07/07/16 Operator: D.Maclachlan

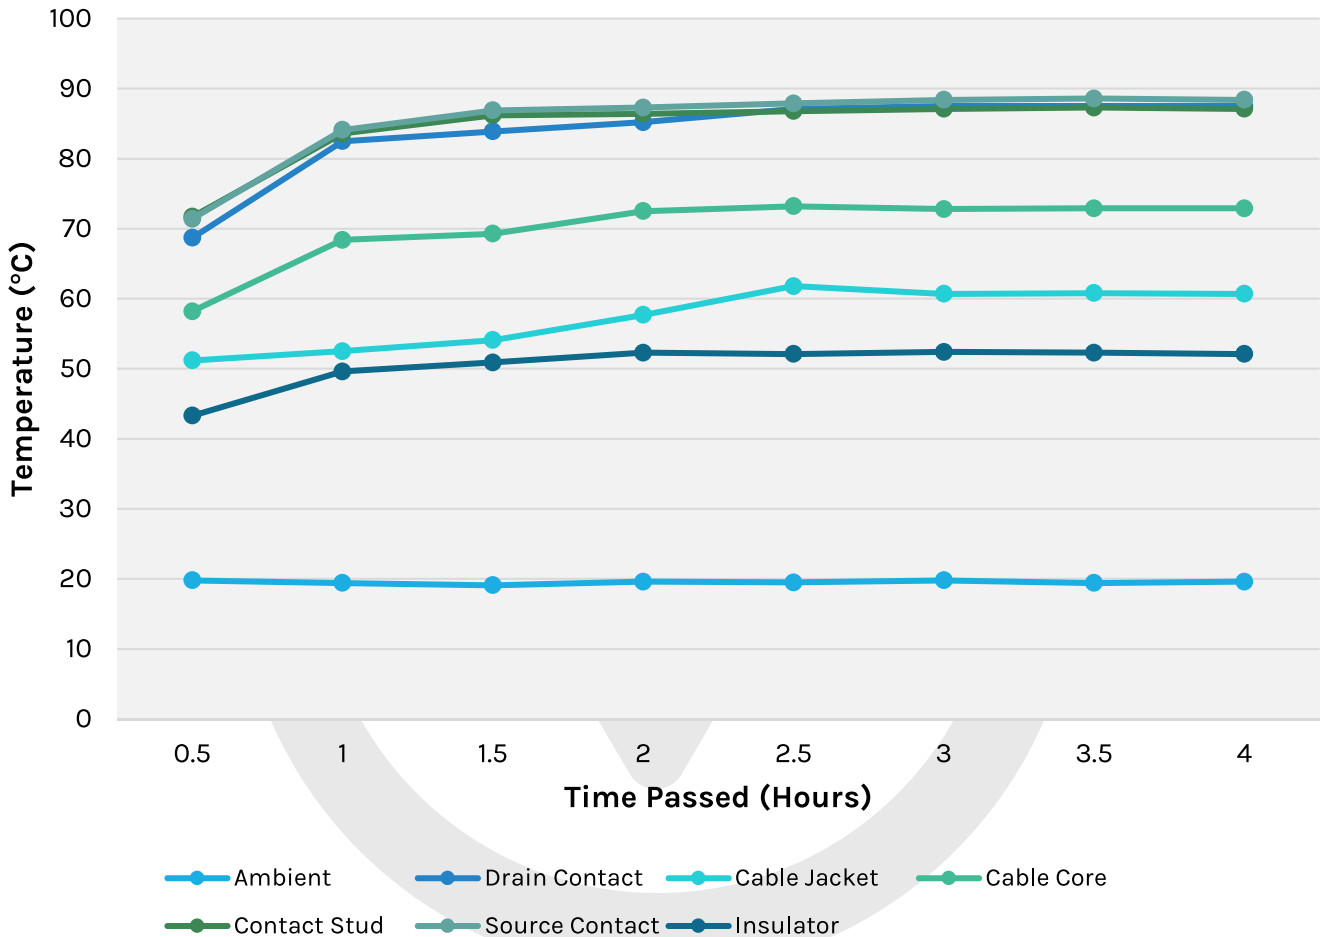

TIME	AMBIENT	DRAIN CONTACT	CABLE JACKET	CABLE CORE	CONTACT STUD	SOURCE CONTACT	INSULATOR	AMPS
0.5	19.8	68.7	51.2	58.2	71.7	71.4	43.3	814.0
1	19.4	82.5	52.5	68.4	83.6	84.1	49.6	808.0
1.5	19.1	83.9	54.1	69.3	86.2	86.9	50.9	806.0
2	19.6	85.2	57.7	72.5	86.4	87.3	52.3	804.0
2.5	19.5	87.1	61.8	73.2	86.8	87.9	52.1	802.0
3	19.8	87.5	60.7	72.8	87.1	88.4	52.4	802.0
3.5	19.4	87.5	60.8	72.9	87.3	88.6	52.3	805.0
4	19.6	87.5	60.7	72.9	87.1	88.4	52.1	805.0

TR-05664

# Powersafe Panel Source T8



Test Date: 07/07/16 Operator: D.Maclachlan

## FINAL RESULTS

PROBE POSITION	TEMPERATURE (C)	T (MEASURED-AMBIENT)	AMPS
Ambient	19.6	N/A	N/A
Line Drain Contact (P1)	87.5	67.9	805A
Cable Jacket (P2)	60.7	41.1	805A
Cable Core (P3)	72.9	53.3	805A
Panel Contact Stud (P4)	87.1	67.5	805A
Panel Source Contact (P5)	88.4	68.8	805A
Panel Source Insulator (P6)	52.1	32.5	805A

## CONCLUSION

MEASUREMENT	RESULT
Maximum Allowable Temperature	125°C
Maximum Recorded Temperature Rise @ Insulated Body (above ambient)	32.5°C
Maximum Allowable Temperature of Contacts	125°C
Maximum Recorded Temperature Rise (above ambient)	68.8°C
TEMPERATURE RISE WITHIN BS EN 61984 -2009 AND VDE ALLOWABLE LIMITS.	PASS



This report is the property of Phase 3 Connectors Ltd and must not, without their written consent, be passed on, copied or used for any other purpose.